

Technical data sheet

Product features



Toaster 3x holders

Model	SAP Code	00004294
TO 930 GH	A group of articles - web	Toasters



- Standard equipment for device: 3x tongs, grid
- Timer: Yes
- Material: Stainless steel
- Indicators: operation and warm-up
- Removable rear wall of the device: Yes
- Container for liquid fat: Yes

SAP Code	00004294	Net Weight [kg]	8.00
Net Width [mm]	453	Power electric [kW]	2.000
Net Depth [mm]	274	Loading	230 V / 1N - 50 Hz
Net Height [mm]	288	Standard equipment for device	3x tongs, grid

Technical data sheet

Technical drawing



Toaster 3x holders

Model


SAP Code

00004294

TO 930 GH

A group of
articles - web

Toasters

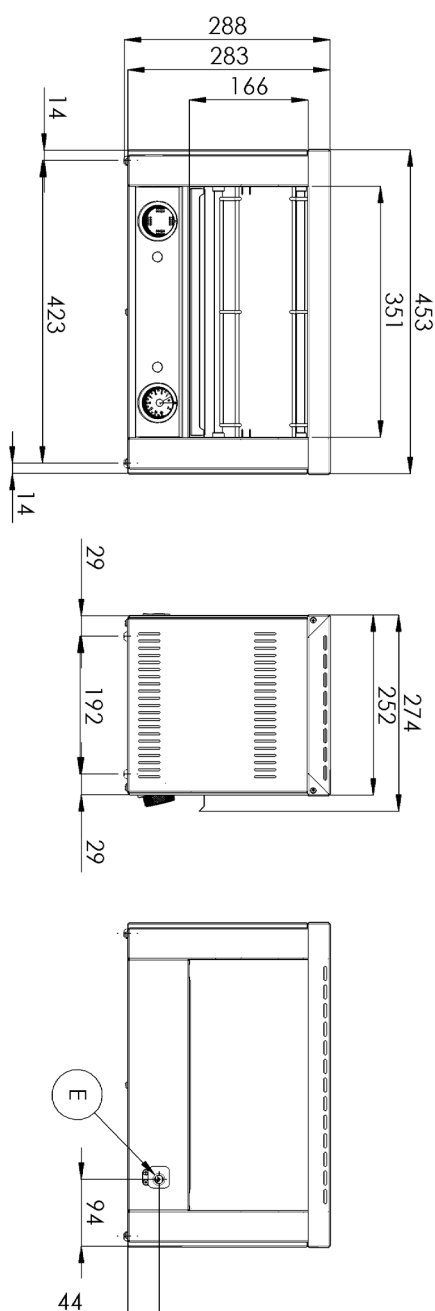

Technical data sheet

Product benefits



Toaster 3x holders		
Model	SAP Code	00004294
TO 930 GH	A group of articles - web	Toasters

1 All-stainless design
only stainless steel intended for food contact is used

2 Run and warm-up light
optical possibility to check the status of the device

3 Separate control for individual sections
the possibility of a heating system separately

4 Catch container for breadcrumbs
breadcrumbs fall outside the furnace

5 Removable back wall
possibility to open the back wall of the device

6 Silicon heaters
immediate onset of heat
intense radiant heat

7 The tongs and grid are part of the standard equipment
I can put the food on the grate or put it in tongs

Technical data sheet

Technical parameters



Toaster 3x holders

Model	SAP Code	00004294
TO 930 GH	A group of articles - web	Toasters

1. SAP Code:

00004294

2. Net Width [mm]:

453

3. Net Depth [mm]:

274

4. Net Height [mm]:

288

5. Net Weight [kg]:

8.00

6. Gross Width [mm]:

355

7. Gross depth [mm]:

500

8. Gross Height [mm]:

320

9. Gross Weight [kg]:

9.00

10. Device type:

Electric unit

11. Construction type of device:

Table top

12. Material:

Stainless steel

13. Power electric [kW]:

2.000

14. Loading:

230 V / 1N - 50 Hz

15. Standard equipment for device:

3x tongs, grid

16. Protection of controls:

IPX4

17. Timer:

Yes

18. Removable rear wall of the device:

Yes

19. Container for liquid fat:

Yes

20. Indicators:

operation and warm-up

21. Cross-section of conductors CU [mm²]:

0,5